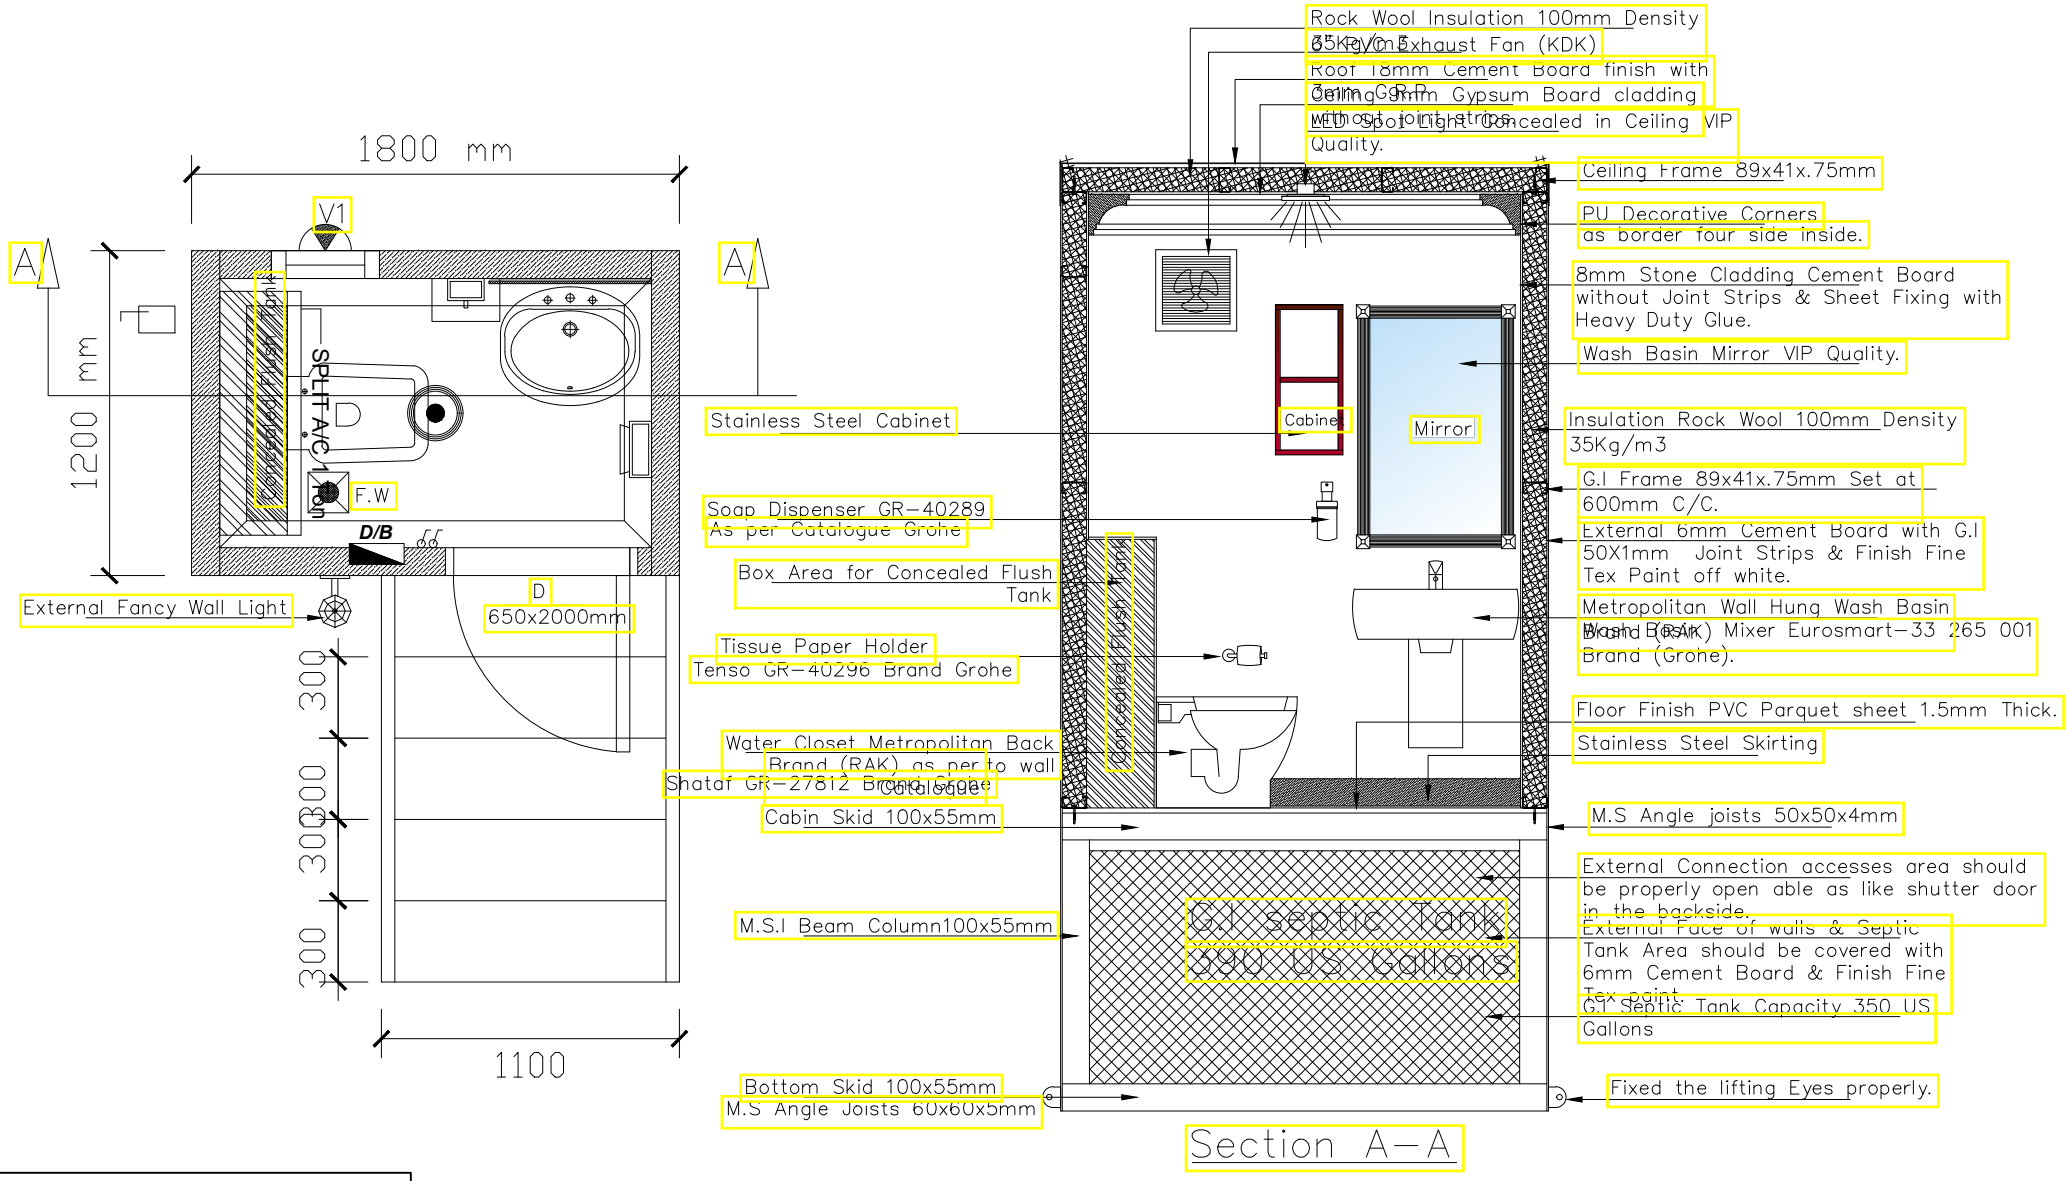


390 USG GALLONS GI

SEPTIC TANK ATTACHED UNDER THE UNIT

LIBERTY

BUILDING SYSTEMS FZC